

DYNAMIC RATING SYSTEMS IN GENERAL AND IN A HIBRID 150 KV TRANSMISSION SYSTEM



Frank DE WILD, KEMA Consulting (Netherlands), Frank.deWild@kema.com
Wim BOONE, KEMA Consulting (Netherlands), Wim.Boone@kema.com
Hans VAN DER GEEST, ContinuoN (Netherlands), Hans.vander.Geest@continuoN.nl
Jacco SMIT, Nuon Tecno (Netherlands), Jacco.Smit@nuon.com

ABSTRACT

In this paper dynamic rating techniques are described, presented, demonstrated and evaluated. Attention is paid to finding thermal bottlenecks in cable circuits, to on-line and off-line applications and to the relation between thermal models and measurements. The possibilities of on-line dynamic rating systems is demonstrated with a pilot project at utility NUON in which a 150 kV connection consisting of an oil filled power cable and an overhead line in series is set up, deployed and verified against real practice. Throughout the paper, attention is paid to the practical application of modern techniques to optimally utilise the possibilities of connections.

KEYWORDS

Dynamic rating, ampacity, thermal bottleneck, hotspot, optimal usage, asset management.

1. INTRODUCTION

The rating of power cables is a very important subject for utilities. After all, power cables are installed to transport power from one place to another in a reliable way. As the transported power is the product of voltage and current, and the voltage is both fixed by the network and tested during installation / commissioning, the current rating of power cables is of great importance.

Utilities have the difficult task to manage many cables, lasting decades. As the ampacity (current carrying capacity) of a cable is usually only determined at the beginning of the lifetime of a cable circuit, ampacity calculations, including their assumptions may have been performed decades ago. In those days, the use of an assumed set of soil conditions and the use of stationary (sometimes simplified) calculations were much more common than nowadays, now that there are ways to determine soil thermal parameters by soil surveys and improved dynamic calculation methods.

With modern techniques, a re-assessment of the ampacity of underground power cables is often advantageous. The thermal inertness of the soil can be used to transport more current than the stationary maximum (the IEC 60287 continuous current rating [1]) without thermally overloading the cable circuit. Techniques are becoming available to determine the actual thermal bottleneck of cable circuits, so that calculations can be focused on the weakest part of the chain [2].

While on the one hand more techniques to assess the true ampacity of power cables are becoming available, on the

other hand utilities are forced more and more to transport energy in the most cost-effective way. As nowadays installing a new cable circuit in an increasingly urbanised environment implies increasing permitting times, increasing numbers of HDD crossings and in general increasingly difficult installation procedures, the capital investments in cable circuits increase. If utilities can invest 'just-in-time' in the network because new techniques determining the cable ampacity are used without introducing unmanageable risks at the same time, this is a very interesting way forward.

An example of what can be realised with the techniques mentioned is described in this paper: the realisation of a dynamic rating system of a 150 kV hybrid connection consisting of an oil filled cable and an overhead line, both without direct temperature measurements as is the usual case with power cables [3]. However, this paper also focuses on new techniques and principles regarding dynamic rating, to be specified in paragraphs 3 and 8.

2. THERMAL BOTTLENECK OR HOTSPOT ?

Regarding definitions, it is proposed to use the term "thermal bottleneck" for that location in a cable route that really limits the cable's ampacity. A "thermal bottleneck" is different from a "hotspot", which is only a location in a cable route with an elevated temperature at a certain time instant.

Example: suppose there is a cable route, partly installed in soil with bad thermal properties and crossing a hot pipe in soil with very good thermal properties. With low loading, the hot pipe will be a hotspot in the cable route, but it will not per definition be the thermal bottleneck. The thermal bottleneck in this situation may very well be the situation with the soil with bad thermal properties, which was not the earlier defined hotspot.

3. APPLICATION OF DYNAMIC RATING

Performing dynamic rating techniques on power cables has many forms and related benefits. In this paragraph a number of application possibilities that have already been applied in practice will be demonstrated and secondly, economic drivers for introducing dynamic rating techniques are mentioned.

3.1. Technical possibilities

Dynamic rating calculations can be performed for all power cables as long as the current flowing through the cables can be monitored or estimated. From gained experience, three important areas of application can be identified:

Return to Session

Checking temperature measurements and relating the results with terrain artefacts enables to perform increasingly intelligent cable route surveys to pinpoint the thermal bottleneck. Although not every variation in temperature can be explained easily and measurement artefacts (noise levels, spatial resolution, thermal response to glass fibre welds) disturb measurements up to a certain level, many temperature artefacts can be related to terrain and installation details and can be used to form 'knowledge rules'. These knowledge rules can be used also in situations with similar installation types but with cables without glass fibres. See for an example figure 4.

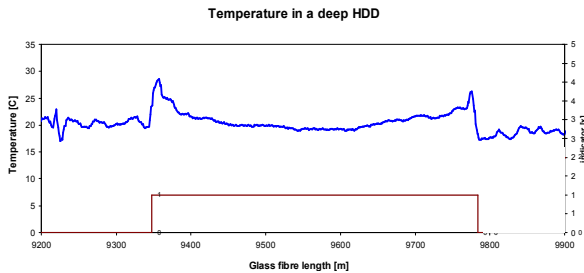


Figure 4: A temperature recording (with glass fibre) of a cable in a deep and long directional drilling. Typical temperature peaks can be seen at the ends of the drilling.

3.2. Economic benefits

Dynamic rating systems are valuable for utilities because they enable optimal utilisation of power cables. What is needed is software, which can be made robust, user friendly and specific for a utility or for an application. The dynamic models only need to be periodically checked using temperature measurements by thermocouple or glass fibres.

Dynamic rating techniques will allow cables to be loaded above their stationary rating for a limited period of time, depending on the cable, installation and operation details. This results in the following economic benefits for utilities:

- **Just-in-time investment** as described in the introduction.
- **Increasing network flexibility.** Energy transport through the network is increasingly less predictable because of less predictable generation (the exact location of energy generation depends on the market request, increasing amounts of wind energy, decentralised generation) and increasingly mobile clients (e.g. datahouses). This calls for a network capable of handling quickly changing energy transports.
- **Better knowledge** of the historic loading of cables and with that, a better knowledge of possible degradation mechanisms acting in the network
- **More possibilities to solve network contingencies.** When the true loading possibilities are known in the control room, the operator can use the system optimally to prevent switching off clients in the case of a network contingency.
- **A more intelligent way of network operation.** When the network consists of cables with dynamic rating systems predicting the future loading possibilities, better options for operation the network may become available, decreasing costs. See paragraph 8.

4. DYNAMIC RATING PILOT PROJECT

A dynamic rating pilot project was set up at Nuon to identify the benefits of dynamic rating as an innovative system to optimise the utilisation of cable systems [3]. The pilot project has been applied to the 150kV connection Diemen – Venserweg in the vicinity of Amsterdam. This connection consists of a double circuit and is one of the backbone feeders of the Amsterdam area. Each circuit consists of an oil filled power cable, an overhead line and again an oil filled power cable in series, both with their own thermal restrictions (see figure 5 for a schematic representation of the circuit under consideration).



Figure 5: A schematic representation of the circuit under consideration.

For investment planning, studies are performed on a yearly basis in order to point out overloaded power connections in the grid. The national power regulator requires that the 150kV grid must be fail-safe under the following emergency conditions:

- A breakdown in the 150kV grid (the "N-1" condition)
- A breakdown during maintenance in the 150kV grid (the "N-2" condition)

From these requirements, the connection Diemen – Venserweg emerged as a high loaded connection during emergency conditions. Both this expected overloading and the differences in thermal behaviour of an overhead line and an underground power cable were the reasons that the connection Diemen – Venserweg was selected to be subject to a dynamic rating system within this pilot project.

5. THERMAL MODEL

The connection was investigated in detail to determine the thermal bottleneck in the cable circuit. The oil filled cable circuit did not contain a glass fibre to ease this search. Therefore, the circuit configuration and environment were studied in detail. Also based on what was learned from 10 years of glass fibre temperature measurements (what has more impact: bad soil or a parallel cable? Also see paragraph 3.1), the thermal bottleneck was identified to be a dyke crossing in the cable route. Based on this thermal bottleneck, a dynamic thermal model of the power cable was set up. A second thermal model was set up for the overhead line, which has a 'moving' hotspot depending on the weather conditions. The thermal models are discussed in the next two subparagraphs.

5.1. Thermal model of the power cable

In the dynamic thermal model of the power cable under consideration, the cable is represented as a ladder network of thermal resistances and capacitances, resulting in a set of equivalent electric network equations. These models are closely related to the relations as described in IEC 60853 [7], although the model used here is able to perform on-line calculations (see paragraph 3.1, item 1).

Return to Session

The actual thermal situation of the thermal bottleneck in the cable is calculated. The on-line data used for this is the actual load delivered by the EMS system. Also the undisturbed soil temperature near the cable circuit is taken into account as a continuously varying parameter. This undisturbed soil temperature is not measured in this pilot project, but is deduced from an investigation towards both the theoretical behaviour and undisturbed temperature measurements in the Netherlands. The resulting curve may be changed by the user or may be replaced by an actual measurement in future.

Modelling the thermal bottleneck found was performed by using available data on the situation, and realistic, but worst case approximations where necessary. This also leads to a certain safety margin in the final results. In a later stage, the models that have been set up were verified by temperature measurements in practice. For this, see paragraph 6.

5.2. Thermal model of the overhead line

The dynamics of an overhead line do not result from thermal inertness as is the case with underground cables. The temperature of the overhead line quickly responds to changes in the loading and in the weather, with time constants in the order of tens of minutes. However, changes in the weather have a large impact on the rating of an overhead line and are therefore very interesting. In many countries it is common to have a summer and a winter rating of an overhead line. In the dynamic rating system, the same idea is used, but on a much finer timescale.

The model used for thermal calculations is described in [8,9]. The model has already been subject to detailed investigations and verifications with measurements [10].

The model is operated based on load and weather data. The weather data is provided once every day and consists of measured data regarding the weather of the day before and the forecasted weather for the next five days. The weather is measured close to the location of the overhead line. The actual thermal situation of the overhead line is calculated based on the *forecasted weather data* and the actual load on the line. About 24 hours after such a calculation, the calculation is repeated with *measured weather data* rather than *forecasted weather data*. This enables assessing the quality of the forecasted weather data, and the influence of using forecasted instead of measured weather data on the actual thermal situation of the overhead line. Based on this information, it could be decided whether an extra safety margin should be included in the calculations because forecasted rather than measured weather data is used.

6. MODEL VERIFICATION

After the dynamic rating system was installed, the dynamic rating model for the power cable was verified with a thermocouple. In a later stage, also the overhead line thermal model will be verified using a direct temperature measurement on the overhead line conductor.

During a period of several months the temperature of the cable and the soil in vicinity of the hotspot has been measured. In this period of time several 'emergency

situations' were simulated by switching off the parallel connection. This enabled recording the heating and cooling of the cable jacket and the surrounding soil.

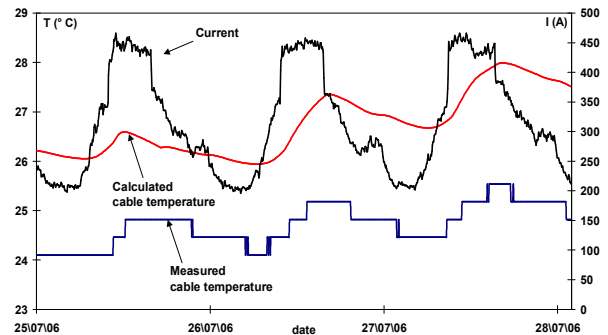


Figure 6: A comparison of the modelled cable (jacket) temperature with the measured cable temperature.

One of the model verifications is presented in figure 6. The discrete character of the measured curve in figure 6 is due to an inaccurate adjustment to the A/D converter. However, from this figure it can be seen that the real-time recording of the cable jacket temperature is in shape equal to the calculated jacket temperature. The measured temperature is somewhat lower than the calculated temperature due to the worst case approximated undisturbed soil temperature (see paragraph 5.1). The steepness of both curves is almost identical in warming-up and cooling-down periods.

7. COLLECTED EXPERIENCE

Within the pilot project, the following major experiences were reached:

- Deploying dynamic rating systems enables increasing circuit loading without exceeding the thermal limits stated. With these systems, higher loads can be transported during emergency situations and financial benefits may be gained by investing just-in-time and by planning maintenance periods efficiently.
- The dynamic rating system has been based on dynamic models rather than on measurements. This is an advantage in the usability, reliability and pricing of such a system.
- Preparatory studies to find the thermal bottleneck in a cable circuit and to evaluate the engineered rating of the cable circuit have a high added value and need to be done before a dynamic rating system is installed.
- An in-depth site and soil survey was necessary to find the hotspot because no glass fibre was present in the transmission connection. For new cable systems one has the choice to integrate glass fibres against relatively low cost. Since glass fibres facilitate the finding of hotspots to a large extent, integrating glass fibres for temperature measurements in new connections is worthwhile.
- Creating a basis in the organisation for innovative techniques as dynamic rating systems needs broad appreciation.
- The model was found to correspond to reality rather good after the model was deployed.

8. REMAINING CHALLENGES

Regarding the application of dynamic rating, there is a very interesting future challenge to be addressed. This is to perform a dynamic rating pilot project for a number of power cables or overhead lines, forming a ring or a mazed grid. When in such a ring or mazed grid the future loading possibilities of all cables and overhead lines can be calculated with dynamic rating systems, another way of network operation can be made available. This enables much more than now a kind of network operation reflecting the business values of a utility: One can try to optimise emergency loading possibilities in the network to prevent switching off clients if a failure occurs, One can decide to load certain connections higher in order to spare other cables and so to keep the network (theoretical) thermal degradation of all connections equal, One can try to lower energy losses by keeping the temperature of cables as low as possible, using the thermal inertness of the systems optimally, et cetera.

Besides exploring these new possibilities, it is very important to keep learning knowledge rules (see paragraph 3.1) from relating measurements with thermal models and thereby improving both cable circuit design and engineering practices and improving finding and describing thermal bottlenecks in underground cables.

A third remaining challenge is to relate the historic thermal load to the cable condition and the remaining life. However, as the subject of degradation and remaining life is very difficult, this topic will probably remain a challenge for the years to come.

Predominantly within Nuon, the following challenges remain to be explored:

- A convincing glass fibre measurement
- A solution for a standalone thermocouple measurement with data functionality

9. CONCLUSIONS

Dynamic rating is a useful technology to optimize operating management of a transmission system, without exceeding maximum temperatures, both from a technical and an economical point of view.

A pilot project is an important tool to collect experience. The pilot project has to be based on an advanced model representing the thermal behaviour of the relevant components.

Interesting elements in the pilot project are in particular: the verification of the thermal model and site /soil surveys to locate thermal bottlenecks.

Finally the Dynamic Rating technology has the following future challenges:

- Application for mazed networks
- Development and application of knowledge rules
- Application of remaining life management

REFERENCES

- [1] IEC 60287, "Calculation of the current rating", 1994.
- [2] G.J. Meijer, 2004, "Aanpakken van bottlenecks in verbindingen, onmisbaar bij implementatie dynamisch netbeheer", National study, only available in Dutch language on: http://www.kema.com/nl/consulting_services/transmission_and_distribution/publications/pr ego/measurements.
- [3] J.C. Smit, R. Trekop, F.H. de Wild, 2006, "A dynamic rating system for an existing 150 kV power connection consisting of an overhead line and an underground power cable", CIGRE 2006, paper B1-305.
- [4] B.J. Grotenhuis, J.E. Jaspers, A. Kerstens, A.H. van der Wey, F.H. de Wild, 2001, "Increasing the capacity of cable system using cable asset management based on thermal and mechanical properties", CIGRE 2001.
- [5] F.H. de Wild, G.J. Meijer, G. Geerts, 2004, "Extracting more value with intelligent cable systems", Transmission and Distribution world magazine, august 2004, p22-27.
- [6] J.G. Sloopweg, A. Postma, F.H. de Wild, 2007, "A practical approach towards optimizing the utilisation of mv cables in routine network planning", CIGRE 2007, paper 0064.
- [7] IEC 60853, "Calculation of the cyclic and emergency current rating of cables", IEC 60853 parts 1 and 2, 1985.
- [8] WG 22-12 CIGRE, 1992, "The thermal behaviour of overhead conductors section 1 and 2: mathematical model for evaluation of conductor temperature in the steady state and the application thereof", Electra No 144, 1992, pp. 107-125.
- [9] WG 22-12 CIGRE, 1997, "The thermal behaviour of overhead line conductors section 3: mathematical model for evaluation of conductor temperature in the unsteady state", Electra No. 174, 1997, pp. 59-69.
- [10] H.L.M. Boot, F.H. de Wild, A.H. van der Wey, G. Biedenbach, 2002, "Overhead line local and distributed conductor temperature measurement techniques, models and experiences at TZH", CIGRE 2002, paper 22-205.